


# 2015 Single Phase Split System Regional Standards

Type	North	South	Southwest
Split A/C	13 SEER	14 SEER	14 SEER / 12.2 EER (<45k btu/h) 14 SEER / 11.7 EER (≥45k btu/h)
		Non compliant units built prior to 2015 may be installed until 6/30/16	
Split Heat Pumps	14 SEER / 8.2 HSPF		

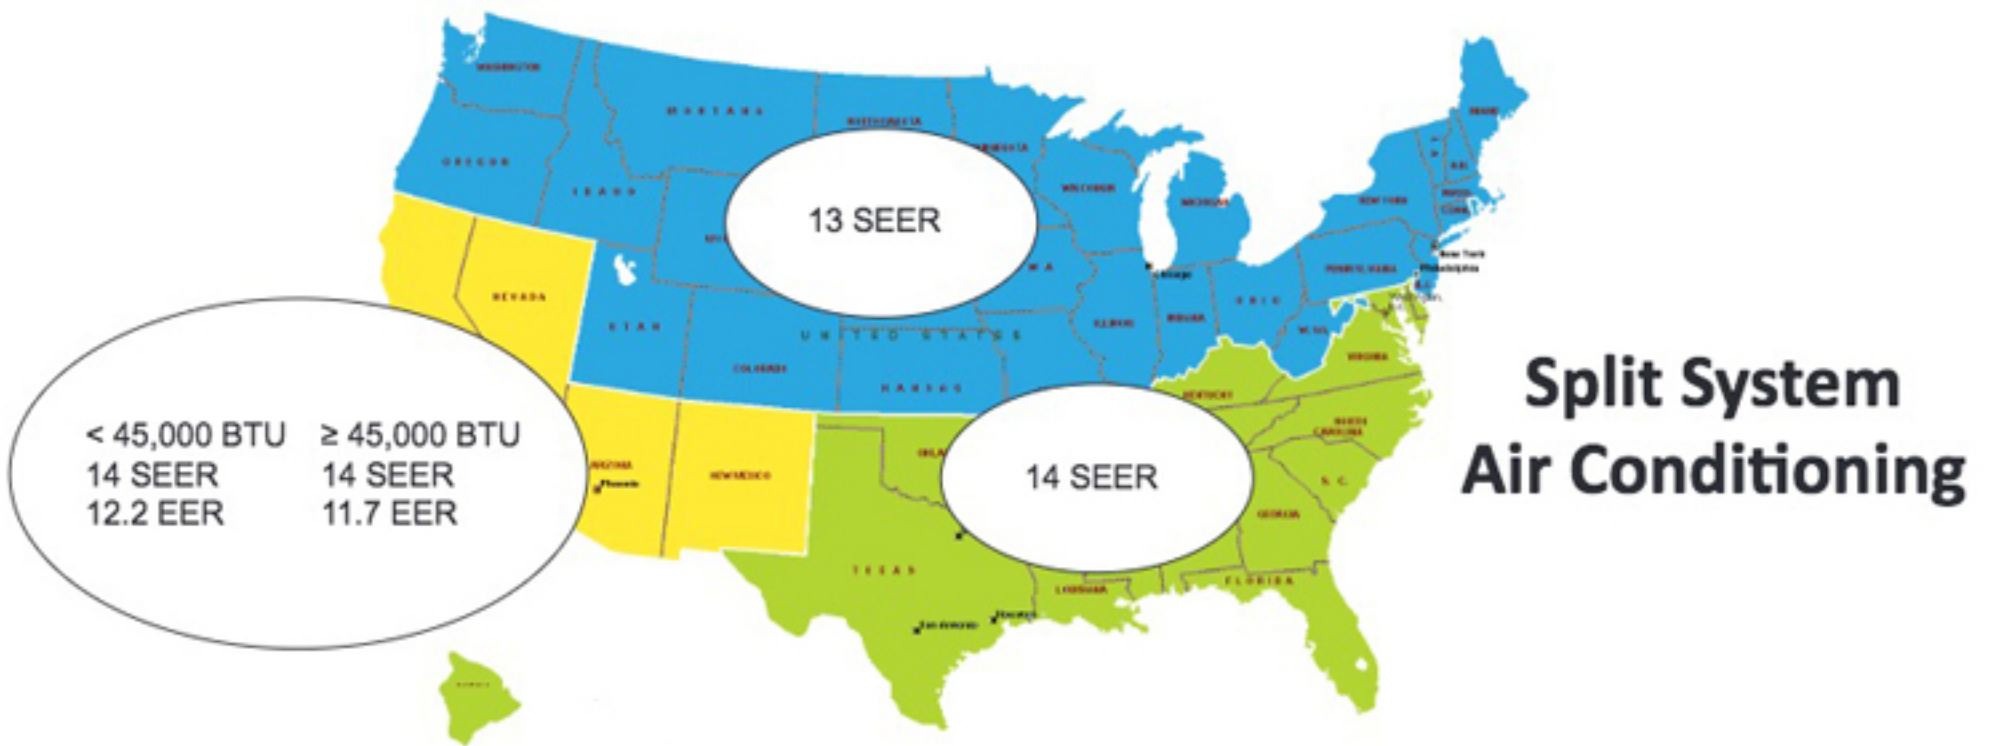

## Department of Energy Residential Products

Equipment	Type	Efficiency		
<b>Cooling</b>	Air Conditioners	See Above		
	Heat Pumps			
	Type	SEER	EER	HSPF
	Space Constrained Products	12		7.4
	High Velocity products	13		7.7
<b>Package Units</b>	All	See Package System Map (Fig. 2)		
<b>Heating</b>	Gas Fired	80% AFUE		
	Oil Fired	83% AFUE		